


# CITY OF Fargo Fire Department

## Flammable and Combustible Liquid Aboveground Tanks


- Fuel tanks require a permit from the Fargo Fire Department IFC 105.7.9
- The contractor and/or tank supplier is required to obtain the permit. Property/business owners will need to hire a flammable/combustible liquid tank contractor.
- The tank contractor shall provide sufficient documentation and pay the application fee to ensure compliance with the fire code. No tanks shall be installed or delivered prior to the fire department issuing a permit.
- Aboveground tanks are restricted to Industrial zoned areas within the City of Fargo. The above ground tank may not be located within 300 ft. of any non-industrial zoned areas. IFC 5704.2.9.6.1
- Above ground tanks permanently connected to an appliance are regulated by Chapter 57 of the IFC and NFPA 30. For example, an aboveground tank connected to a generator.
- Fuel Dispensing is more restrictive and regulated by Chapter 23 of the IFC and NFPA 30A
- Dispensing of class 1 flammable liquids such as Gasoline requires the use of a **UL 2085** tank. IFC 2306.2.3
- Individual tank size is limited to 12,000 gallons. IFC 2306.2.3
- Please note the separation requirements illustrated below that are based on the tank construction and listing. IFC table 2306.2.3

### UL 142 tanks

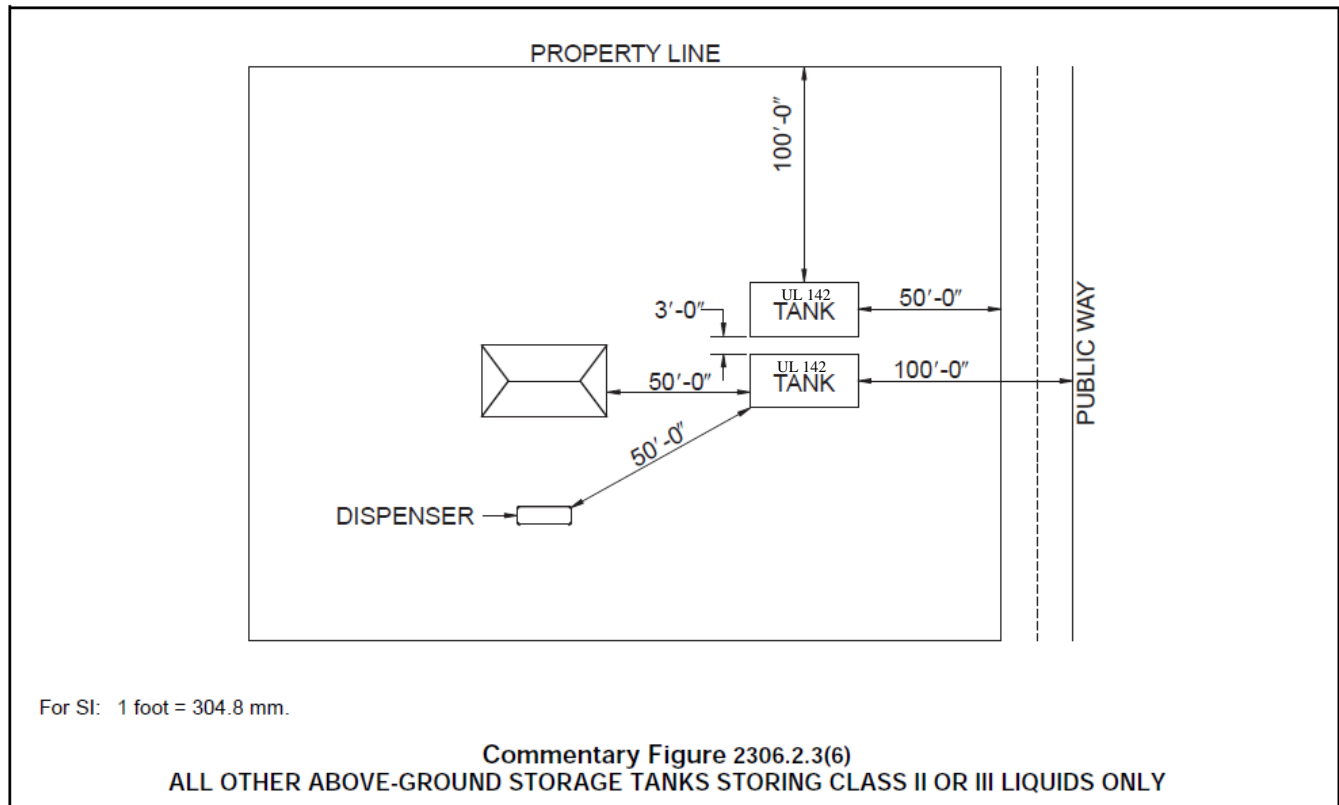


# CITY OF Fargo Fire Department

## UL 2085 tanks

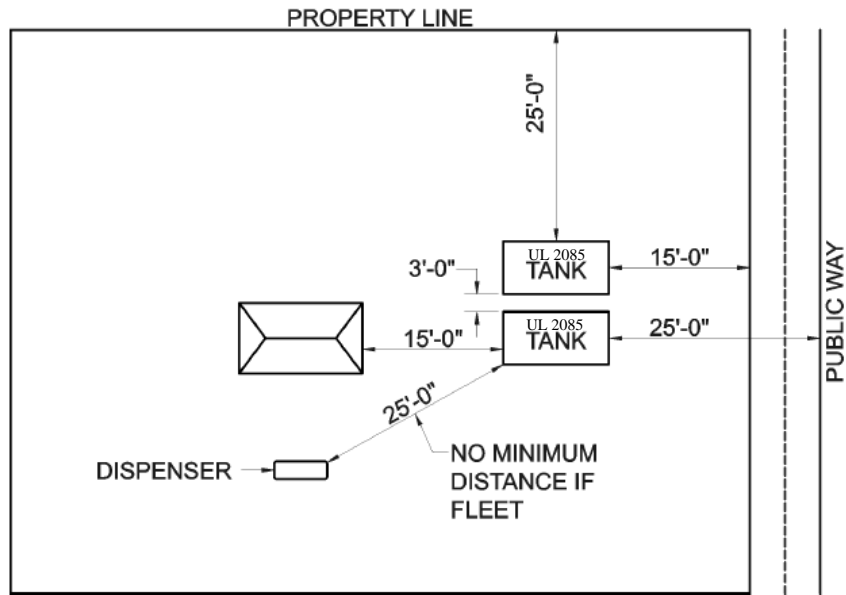

For SI: 1 foot = 304.8 mm, 1 gallon = 3.785 L.

**Commentary Figure 2306.2.3(5)**  
**GREATER THAN 6,000-GALLON PROTECTED ABOVE-GROUND**  
**STORAGE TANKS STORING CLASS I, II OR III LIQUIDS**

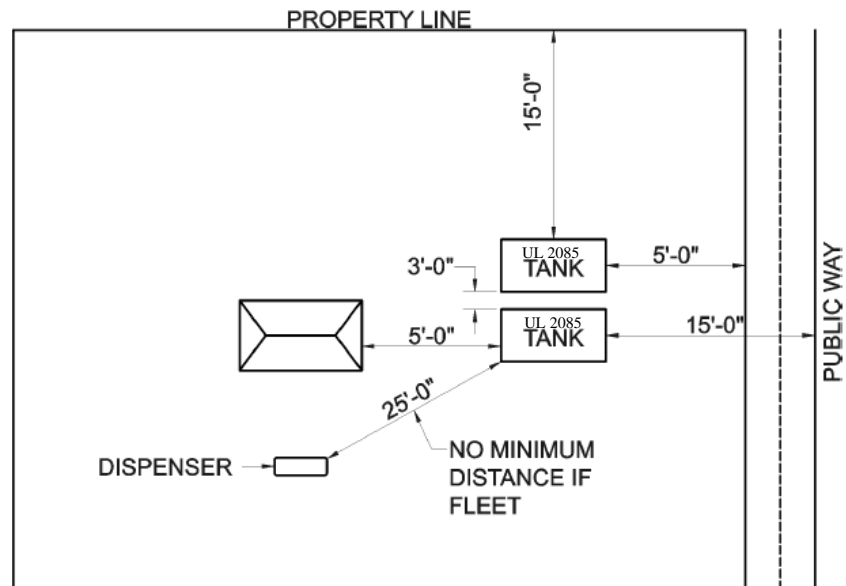

For SI: 1 foot = 304.8 mm, 1 gallon = 3.785 L.

**Commentary Figure 2306.2.3(4)**  
**6,000-GALLON OR LESS PROTECTED ABOVE-GROUND STORAGE TANKS STORING CLASS I, II OR III LIQUIDS**

# CITY OF Fargo Fire Department

- Check the tanks label to determine tank construction and tank listing. Below are two examples:

